


Inlet note: Use a sanitary tee with pipe extension to meet the NYSDOH requirement for baffle 16" below liquid level.

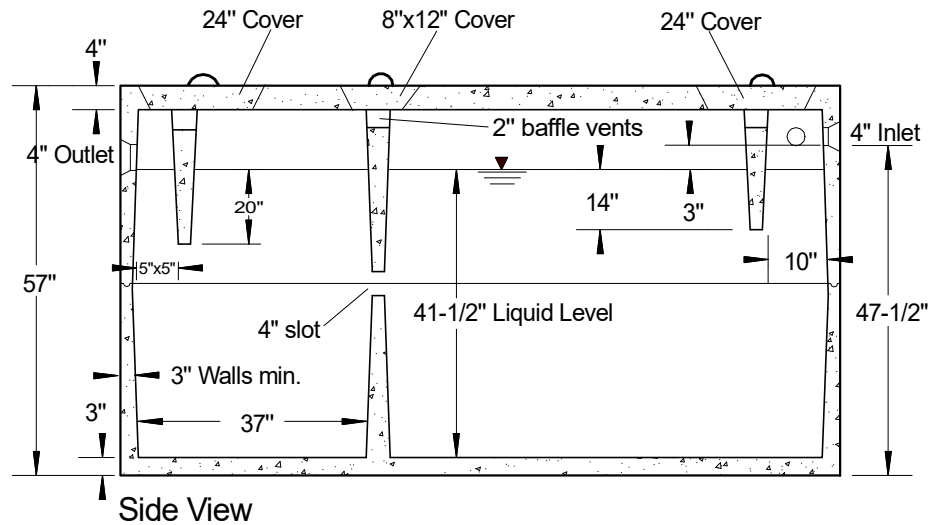

SPECIFICATIONS	
<p>Concrete Min. Strength: 4,000 psi at 28 days            Reinforcement: 6"x6"x10ga. Wire Mesh            Air Entrainment: 6%            Construction Joint: Butyl Rubber Sealant            Pipe Connection: Polylok Seal (patented)            Weight = 9,800 lbs            Load Rating: 300 psf</p>	<p><b>LOW PROFILE SEPTIC TANKS</b>  <b>MODEL LB-1250 / 1250 GALLONS</b></p> <hr/> <p><b>Woodard's Concrete Products, Inc.</b>            629 Lybolt Road, Bullville, NY 10915            (845) 361-3471 / Fax 361-1050</p> <p>Page 11A 3/21/22</p>